



2023-03-23

2023 03 23

2023 03 23


FX5U PLC CCLINK\_IE\_Field Basic JP-CE IO

FX5U PLC CCLINK\_IE\_Field Basic JP-CE IO GX-  
WORKS3 IO

- GX-WORKS3

1. FX5U PLC IO
2. PLC Ethernet CCLINK\_IE\_Field Basic IO


LAEConfig IP IP 192.168.0.x

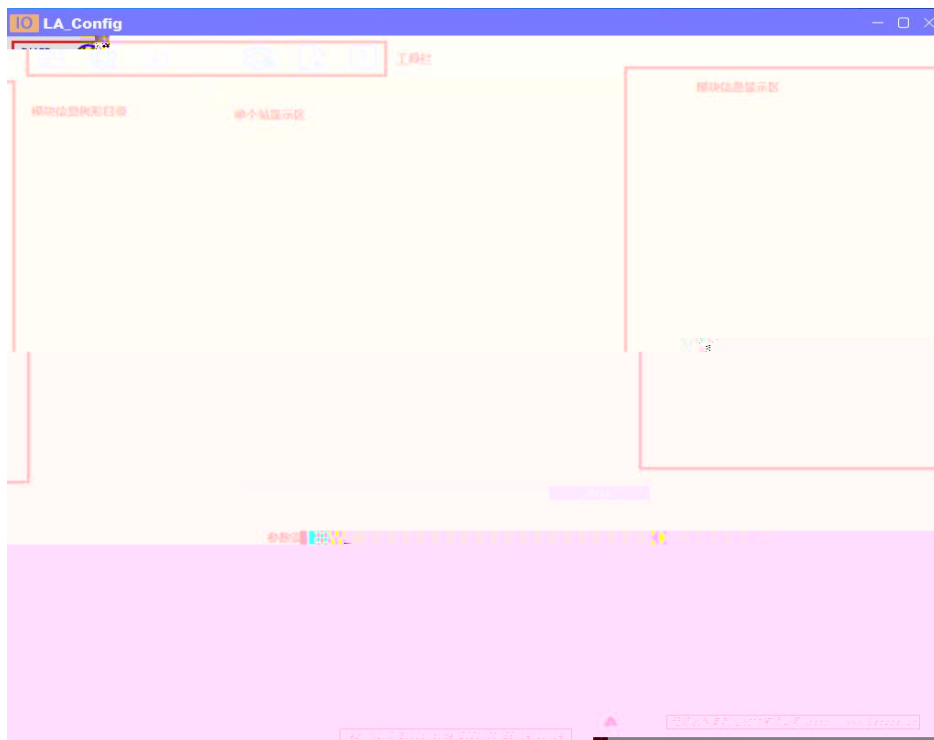







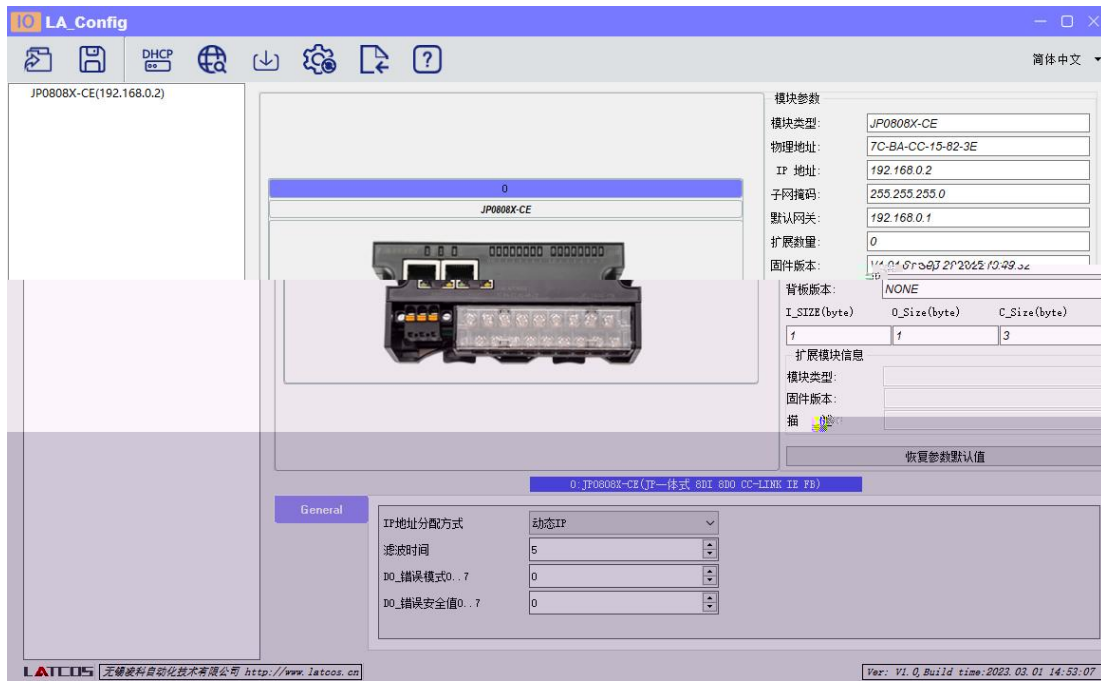

/

1

2) DO\_ 0..7 DQ0.x bit DQ0.x  
Bit0 DQ-0.0 "Error Mode" bit "1"

"Error Value[7..0]" bit DQ0.x

3) DO\_ 0..7 "Error Mode[7..0]" bit

DQ

4)













