2023-03-23

2023-03-23							
	2023	03	23		2023	03	23

\_\_\_\_\_

-----

FX5U PLC CCLINK\_IE\_Field Basic JP-CE IO


FX5U PLC CCLINK\_IE\_Field Basic JP-CE IO GX-WORKS3


- GX-WORKS3

1. FX5U PLC IO

2. PLC Ethernet CCLINK\_IE\_Field Basic IO

LAEConfig IP IP 192.168.0.x

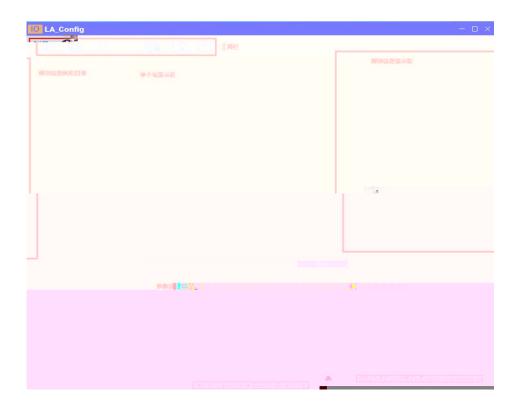

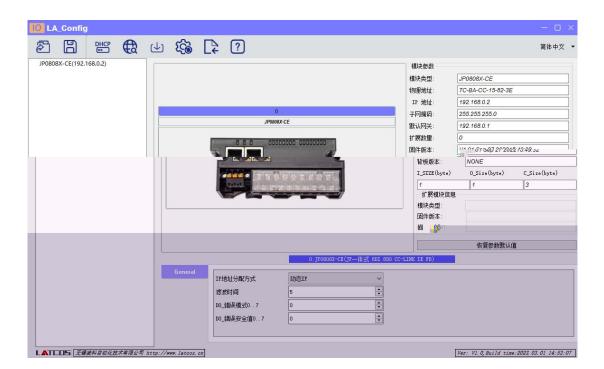



**₩** 

/

1

4) " 🔱

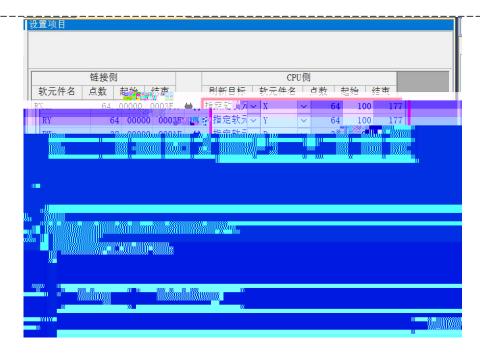

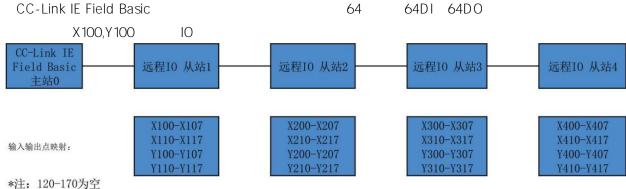

PLC "CC-Link IE

Field Basic IO

